



SZCZEGÓŁ BLOKU OPOROWEGO DLA RUROCIĄGÓW CIŚNIENIOWYCH

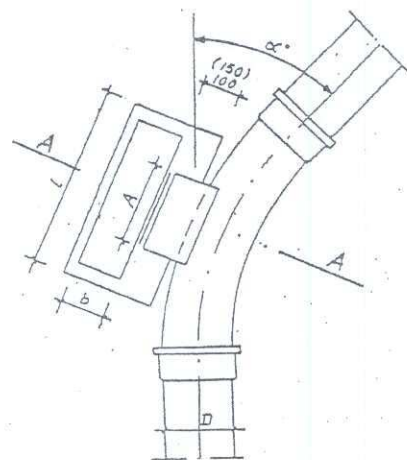

WYMIARY BLOKÓW OPOROWYCH
DLA CIŚNIENIA PRÓBNIEGO 1,0 MPa

Średnica nominalna D mm	Kąt α załamania	A mm	B mm	h mm	b mm	l mm
50-80	90	200	200	200	200	300
	45	200	200	200	200	200
100	90	300	200	200	200	350
	45	300	200	200	200	300
	30	300	200	200	200	300
150	90	400	200	300	250	850
	45	400	200	300	250	600
	30	400	200	300	250	500
200	90	600	250	450	250	1100
	45	500	250	450	250	600
	30	450	250	450	250	550
250	90	700	300	600	380	1350
	45	550	300	600	380	650
	30	500	300	600	250	500
300	90	800	400	650	380	1500
	45	550	400	650	380	850
	30	500	400	650	250	700


PRZĘKRÓJ A - A

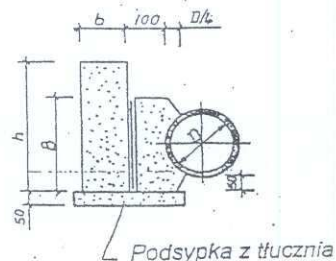


BETON B-10

SZCZEGÓŁ BLOKU OPOROWEGO DLA RUROCIĄGÓW CIŚNIENIOWYCH PRZY ZAŁAMANIU TRASY Z POZIOMU W GÓRĘ

PRZĘKRÓJ A - A

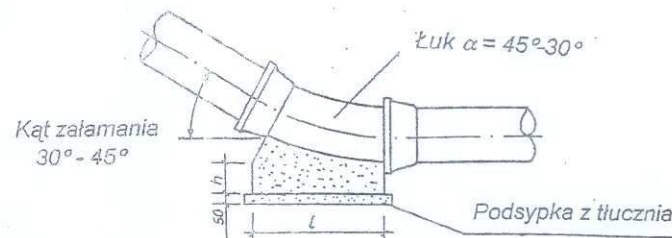


PRZĘKRÓJ B - B



WYMIARY BLOKÓW OPOROWYCH

Średnica wewn. D mm	Kąt α załamania	h mm	A mm	l mm
100	45	100	300	300
	30	180	300	300
150	45	150	400	400
	30	150	350	350
200	45	200	600	600
	30	200	400	400
250	45	250	700	700
	30	250	600	600
300	45	250	750	750
	30	250	700	700

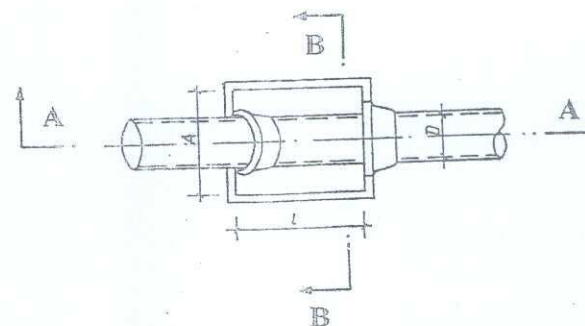

BETON B-10



82-200 MALBORK Al. Wojska Polskiego 90A/b tel. (0-55) 272-70-81 e-mail: biuro@hydroterm.strefa.pl NIP 579-113-23-72

ZADANIE:	Projektant:	mgr inż. A. Papaj upr. 1529/EI/90	Skala:
LOKALIZACJA:	Asystent:	tech. K. Zelman	Rys.
GROBELNO, GM. MALBORK DZ NR 169, 109/1, 110, 64/9, 64/8			7
TYTUŁ RYS.	Sprawdził:	mgr inż. J. Popławski upr. POM/0139/POOS/04	Nr zlecenia
SZCZEGÓŁ BLOKÓW OPOROWYCH cz. II			9215