


SZCZEGÓŁ BLOKU OPOROWEGO DLA RUROCIĄGÓW CISNIENIOWYCH PRZY ROZGAŁĘZIENIU TRASY


blok 1

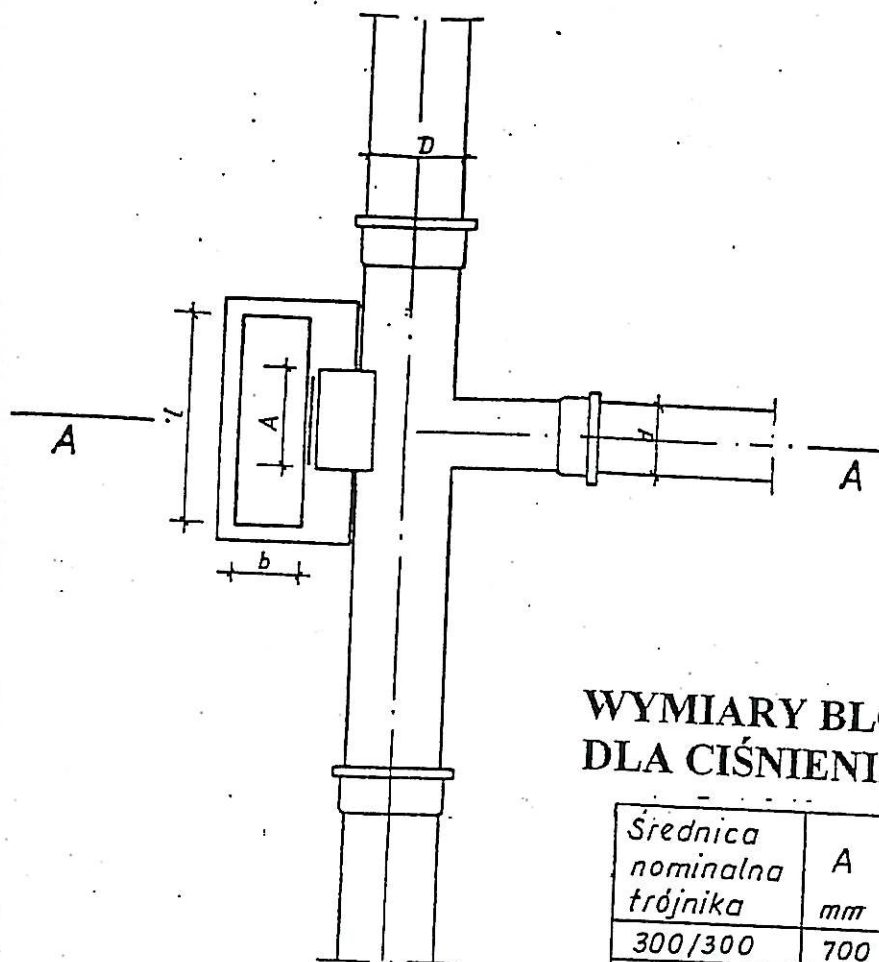

WYMIARY BLOKÓW OPOROWYCH
DLA CIŚNIENIA PRÓBNEGO 1,0 MPa

Srednica nominalna trójnika	A mm	B mm	h mm	b mm	l mm
300/300	700	400	600	400	950
300/250	600	300	400	300	950
250/250					
250/200	500	250	300	300	850
200/200					
200/150	400	200	300	300	500
150/150					
150/100	300	200	300	250	350
100/100					
100/80	200	200	250	200	250
80/80					

PRZEKRÓJ A - A

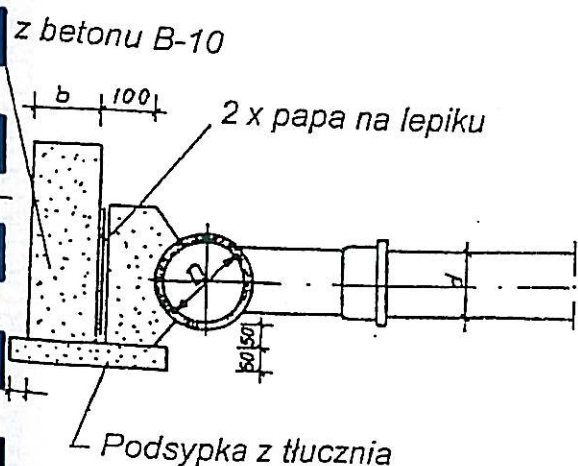

Rys.

10