


SZCZEGÓŁ BLOKU OPOROWEGO DLA RUROCIĄGÓW CISNIENIOWYCH PRZY ZAŁAMANIU TRASY Z POZIOMU W DÓŁ


BETON B-10

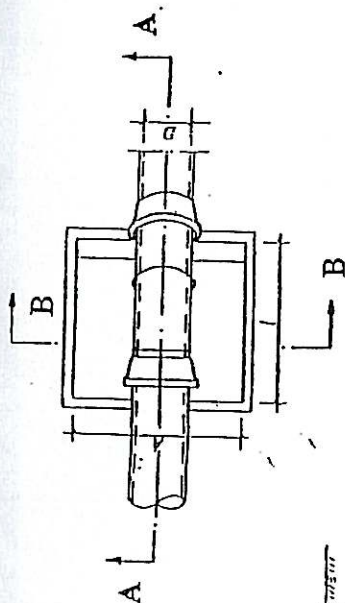

PRZEKRÓJ A-A

Pręty stalowe z końcówkami
gwintowanymi dług. $0,5\pi D + D$


PRZEKRÓJ B-B

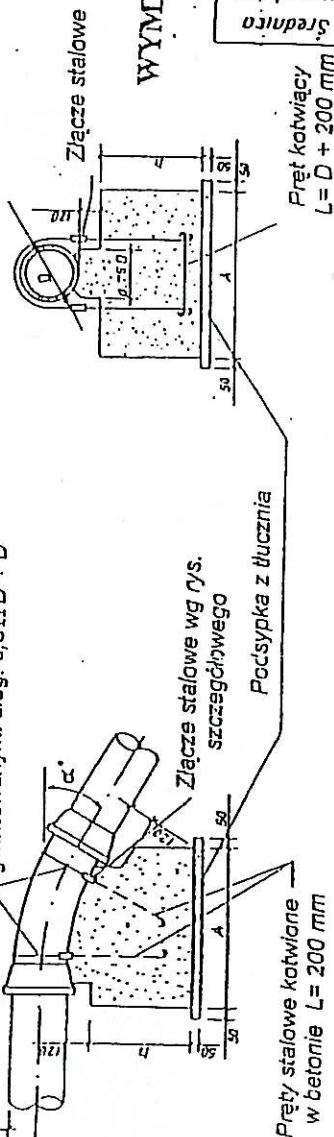

WYMIARY BLOKÓW OPOROWYCH I UCHWYTÓW

Średnica wewnętrzna D mm	Kąt załamania α°	h mm	A mm	l mm	Średnica ściegu mm
100	45	300	500	500	10
150	30	300	300	500	10
200	45	500	800	800	13
250	30	500	800	800	13
300	45	700	1000	1000	13
	30	600	800	800	13
	45	800	1100	1100	16
	30	700	1000	1000	16
	45	1100	1300	1300	25
	30	900	1200	1200	16


SZCZEGÓŁ ZAKOTWIENIA PRĘTÓW




WYMIARY ZŁĄCZY UCHWYTÓW

Średnica uchwyty d mm	Typ I			Typ II		
	A mm	l mm	B mm	A mm	l mm	B mm
10	23	90	55	21	90	5
13	29	100	65	25	100	5
16	35	125	85	32	125	6
19	41	150	90	38	150	6
22	44	175	110	44	175	8
25	51	200	120	51	200	8
						40

TYP I

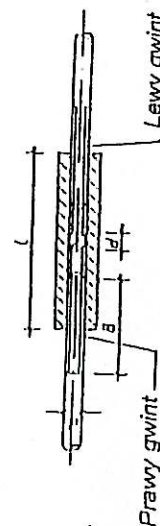

TYP II

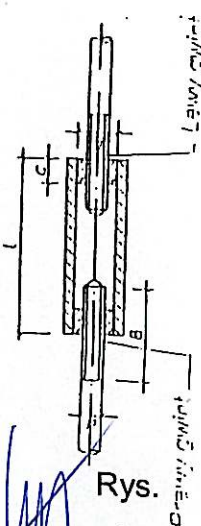

Rys.

blok III